

CONSTRUCTION SPECIFICATIONS




CONCRETE PROPERTIES 5000psi (35Mpc) Minimum Strength
 4-7% Air Entrainment
 RISER COVER MAY BE USED WITH EXTENSIONS
 PLASTIC INLET AND OUTLET Baffle
 4" INLET/OUTLET
 MEETS CSA-B66-05
 REINFORCING MEETS: G30.14.M1983
 ASTM C1116 TYPE III

ENGINEERED FOR 1M OF BURIAL DEPTH

MATERIALS:
 CONCRETE: TYPE 10 PORTLAND, 35MPa AT 28 DAYS
 STANDARD SEE B66-05 SECTION 5

NOTES:
 1. DELIVERY IS MADE BY CRANE EQUIPPED TRUCKS
 EXCAVATION SHOULD BE 1FT LARGER THAN THE TANK
 MINIMUM DIMENSIONS AND ACCESSIBLE FOR UNLOADING
 FRONT THE REAR OF THE TRUCK
 MINIMUM OVERHEAD CLEARANCE OF 18FT IS REQUIRED

2.FOR INSTALLATION INSTRUCTIONS REFER TO CSA AND
 STANDARD PRACTICE MANUALS

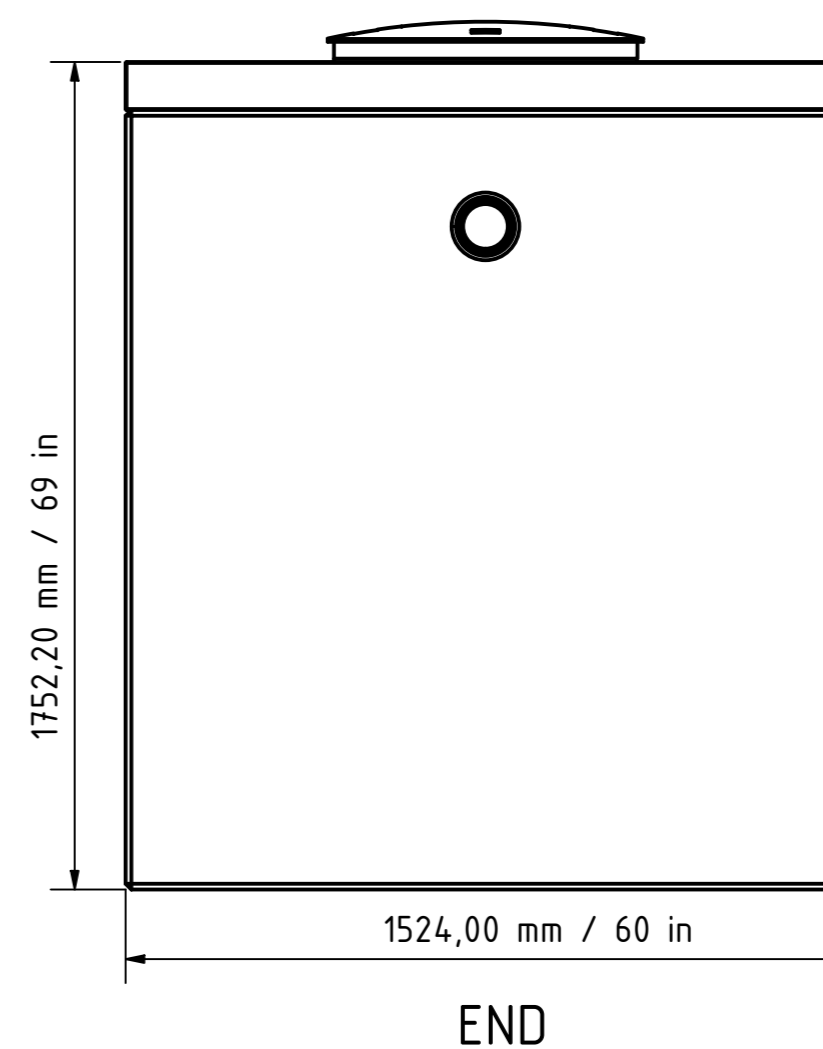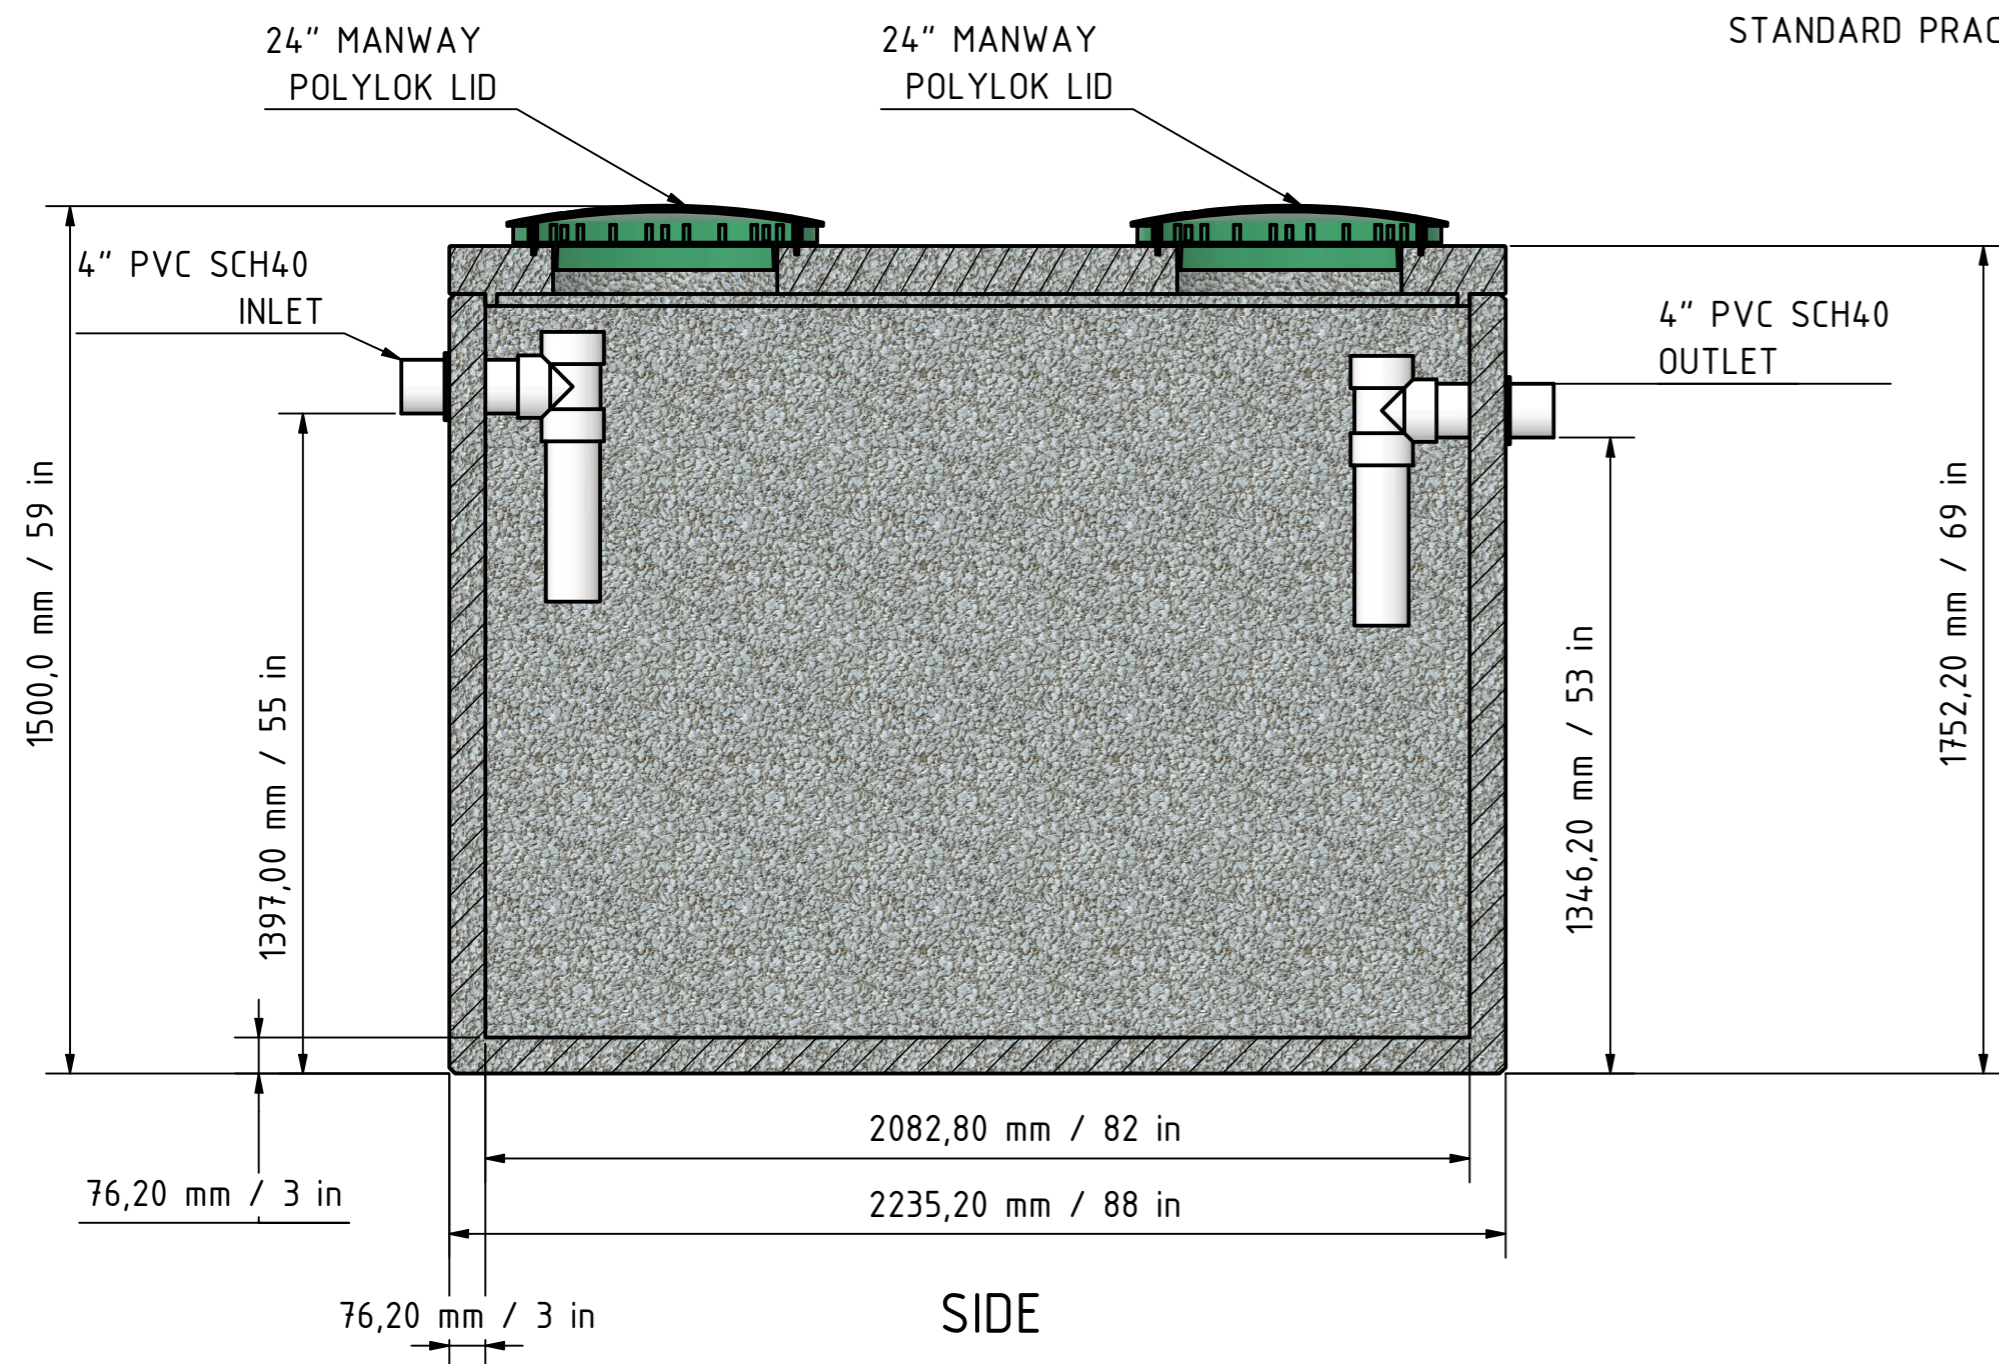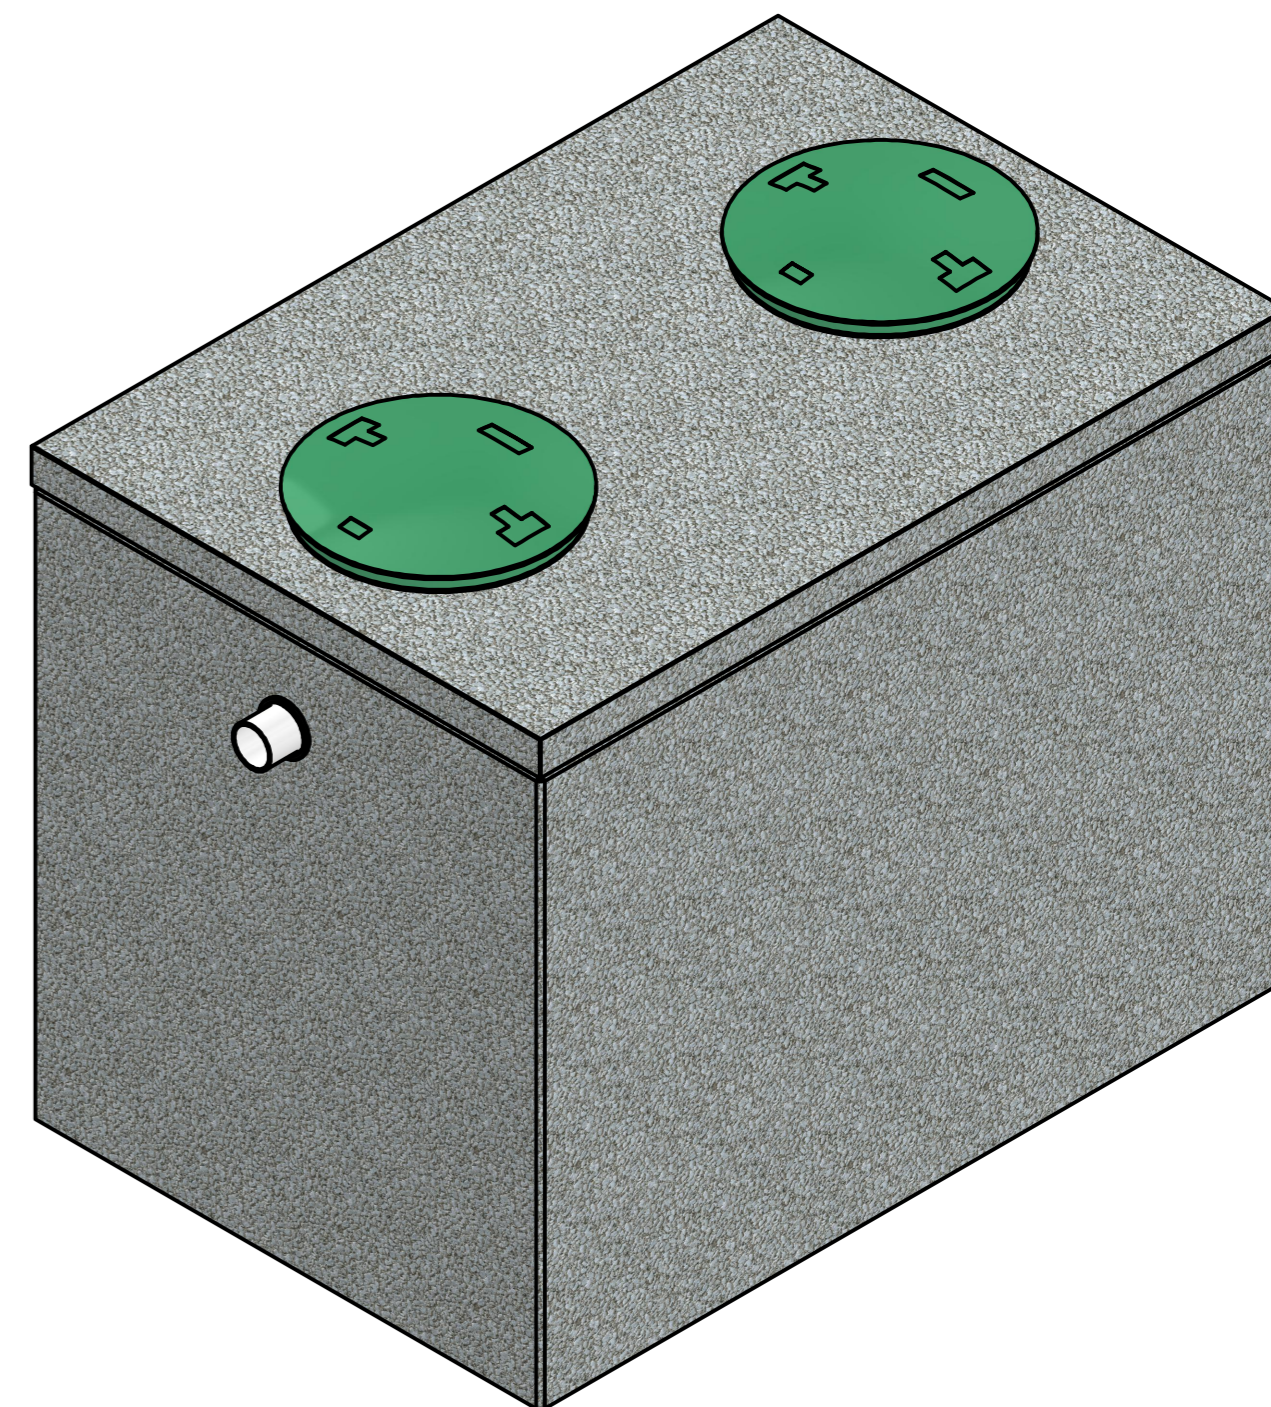

WEIGHT - 7750 LBS

IMPERIAL GALLONS PER INCH -
 15.96



DRAWN BY:KEIR	DATE 2025-03-03
MANCO SEPTIC SOLUTIONS	
900 PUMP CHAMBER	
900 IMPERIAL GALLONS - 4086 LITER	